


PLAN

NOTES:

1. A GROOVE JOINT 1" DEEP WITH 1/3" RADII SHALL BE REQUIRED IN THE CONCRETE SIDEWALK AT 5' INTERVALS. ONE 1/2" EXPANSION JOINT WILL BE REQUIRED AT 40' INTERVALS. A 1/2" EXPANSION JOINT WILL BE REQUIRED WHERE THE SIDEWALK JOINS ANY RIGID STRUCTURE.
2. ALL CONCRETE TO BE 3600 P.S.I. COMPRESSIVE STRENGTH.
3. SEE STANDARD T_4.02 FOR DETAIL OF EXPANSION JOINT AND GROOVE JOINT.
4. MONOLITHIC CURB AND SIDEWALK TO BE CONSTRUCTED ONLY AT APPROVED LOCATIONS BY THE DIRECTOR OF ENGINEERING

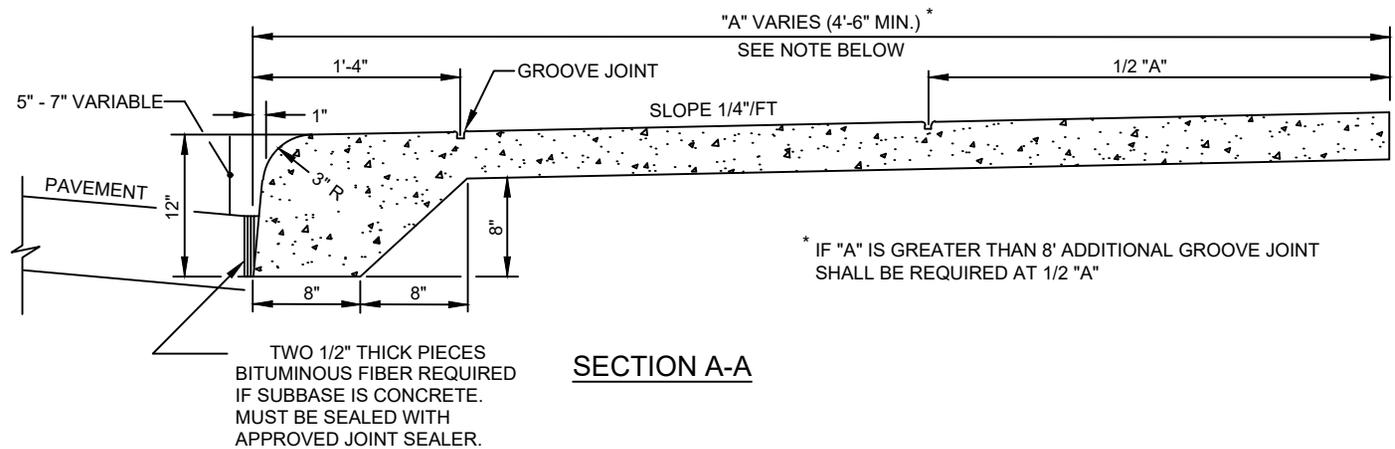

**TOWN OF INDIAN TRAIL
STANDARD DETAIL**

**MONOLITHIC CONCRETE
CURB & SIDEWALK**

REVISIONS	Scale
	Not To Scale
	Revision Date
	02/2021
	Detail #
	T_7.01